


Автоклав № 5

Дата 03.06.2015 12:36:55

ОТЧЕТ за цикл №2

Начало 03.06.2015 9:10:31
конец 03.06.2015 12:36:25

Страница 1 из 3

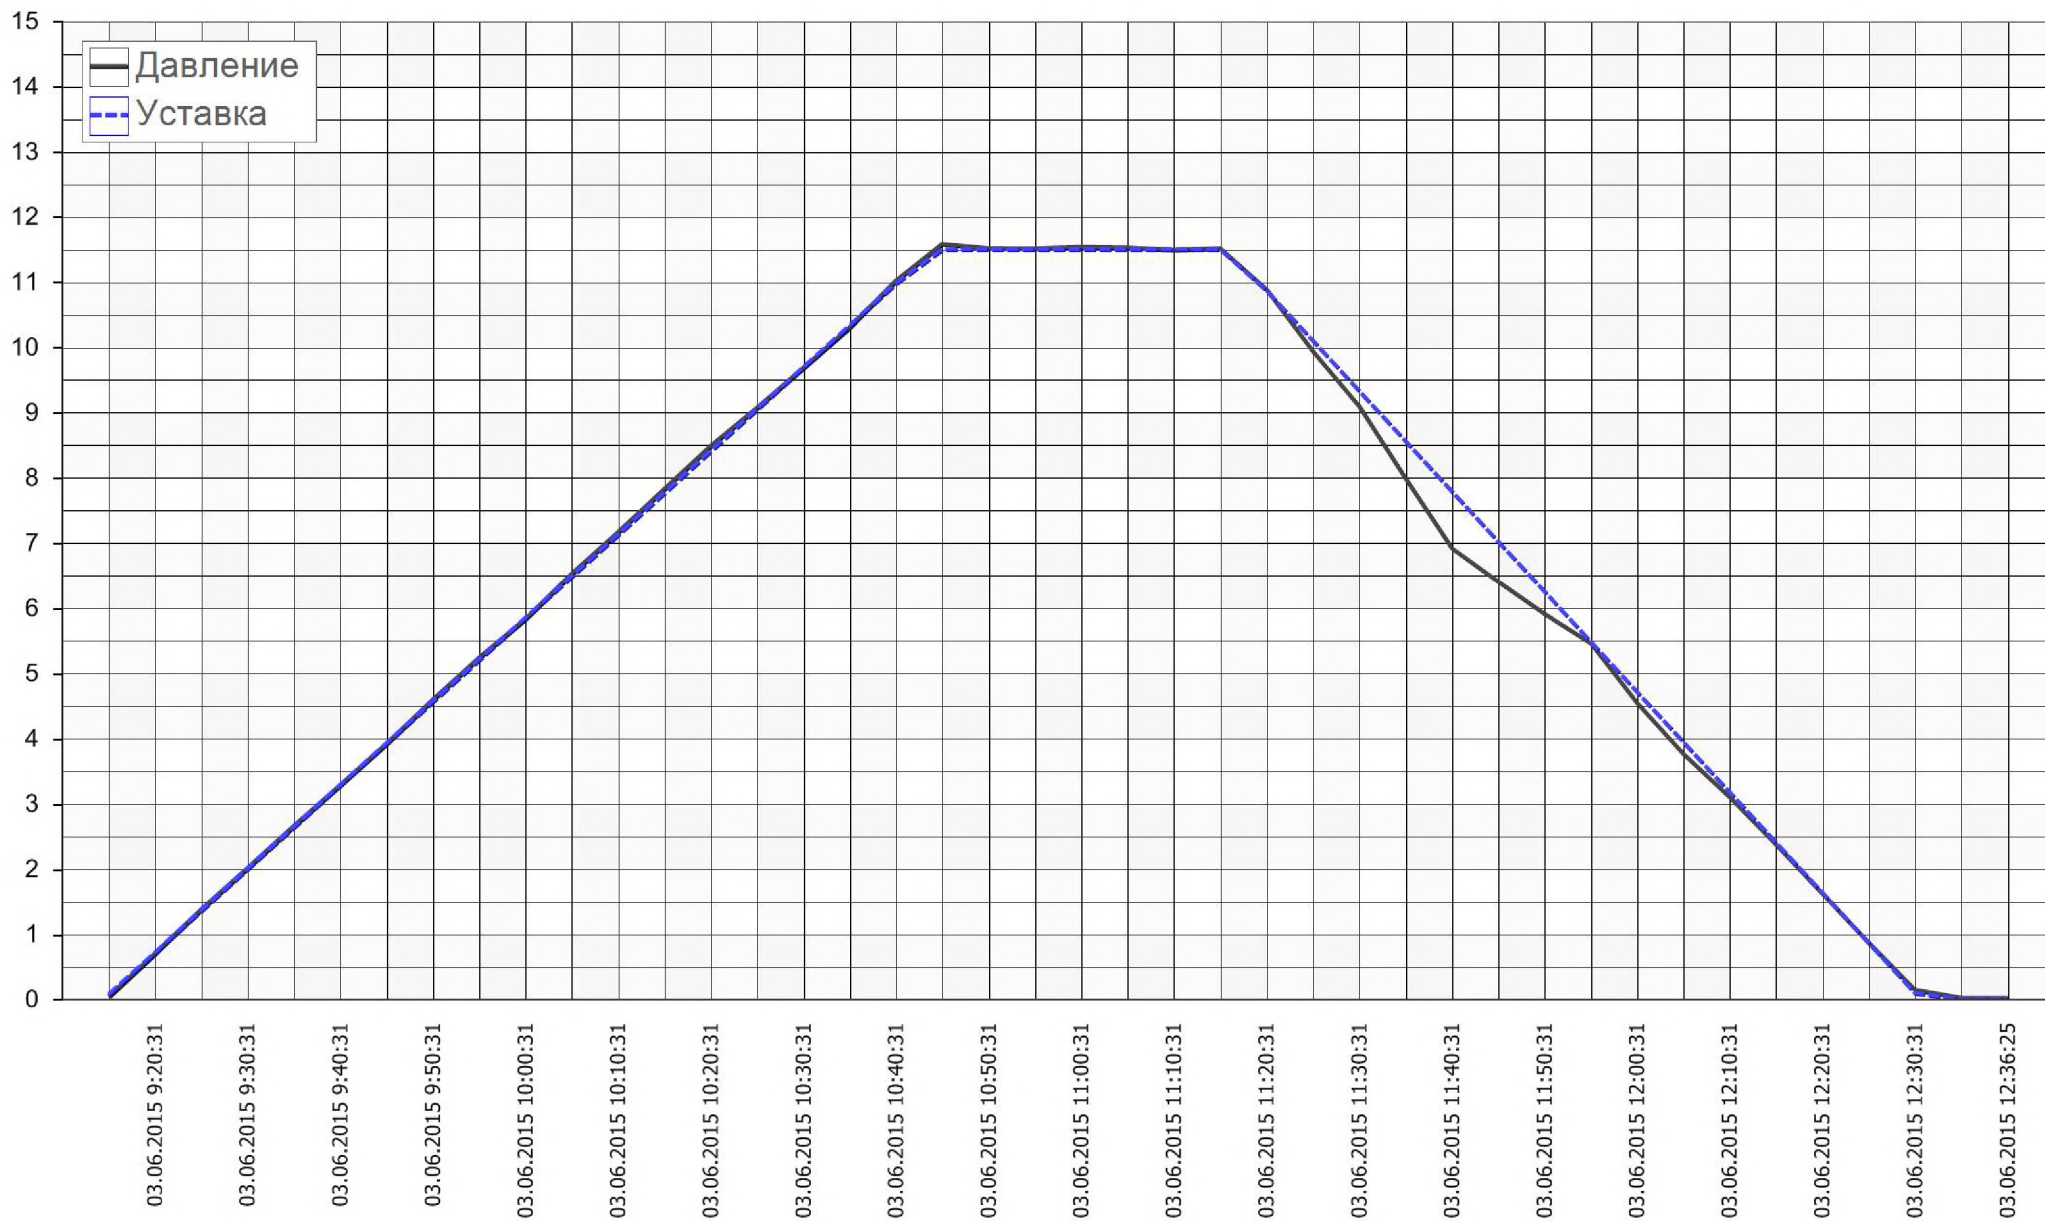

Время	Температура	Разность	Давление	Уставка
03.06.2015 9:15:31	28.00	1.25	0.04	0.08
03.06.2015 9:20:31	89.00	-6.45	0.70	0.72
03.06.2015 9:25:31	111.00	2.72	1.38	1.36
03.06.2015 9:30:31	123.00	14.95	2.01	2.00
03.06.2015 9:35:31	131.00	23.52	2.66	2.64
03.06.2015 9:40:31	138.00	21.85	3.28	3.28
03.06.2015 9:45:31	144.00	16.57	3.92	3.93
03.06.2015 9:50:31	150.00	13.40	4.59	4.57
03.06.2015 9:55:31	155.00	10.22	5.24	5.21
03.06.2015 10:00:31	159.00	8.98	5.83	5.85
03.06.2015 10:05:31	164.00	8.45	6.53	6.49
03.06.2015 10:10:31	167.00	8.48	7.17	7.13
03.06.2015 10:15:31	171.00	8.18	7.83	7.77
03.06.2015 10:20:31	174.00	8.13	8.49	8.41
03.06.2015 10:25:31	177.00	7.82	9.07	9.05
03.06.2015 10:30:31	180.00	7.35	9.68	9.70
03.06.2015 10:35:31	183.00	7.48	10.30	10.34
03.06.2015 10:40:31	186.00	7.20	11.02	10.98
03.06.2015 10:45:31	188.00	7.02	11.58	11.50
03.06.2015 10:50:31	188.00	5.90	11.52	11.50
03.06.2015 10:55:31	188.00	5.20	11.51	11.50
03.06.2015 11:00:31	189.00	4.70	11.54	11.50
03.06.2015 11:05:31	189.00	4.35	11.53	11.50
03.06.2015 11:10:31	189.00	4.30	11.49	11.50
03.06.2015 11:15:31	189.00	3.95	11.52	11.50
03.06.2015 11:20:31	187.00	3.22	10.88	10.87
03.06.2015 11:25:31	183.00	2.23	9.94	10.10
03.06.2015 11:30:31	181.00	2.77	9.09	9.33
03.06.2015 11:35:31	176.00	4.45	7.99	8.56
03.06.2015 11:40:31	179.00	7.40	6.92	7.79
03.06.2015 11:45:31	181.00	10.23	6.41	7.02
03.06.2015 11:50:31	181.00	12.63	5.91	6.25
03.06.2015 11:55:31	180.00	14.52	5.46	5.48
03.06.2015 12:00:31	178.00	16.65	4.55	4.71
03.06.2015 12:05:31	177.00	19.78	3.77	3.95
03.06.2015 12:10:31	176.00	24.00	3.10	3.18
03.06.2015 12:15:31	175.00	28.73	2.38	2.41
03.06.2015 12:20:31	174.00	33.55	1.62	1.64
03.06.2015 12:25:31	172.00	34.17	0.87	0.87
03.06.2015 12:30:31	171.00	32.42	0.15	0.10
03.06.2015 12:35:31	171.00	29.98	0.03	0.00
03.06.2015 12:36:25	171.00	29.60	0.02	0.00